
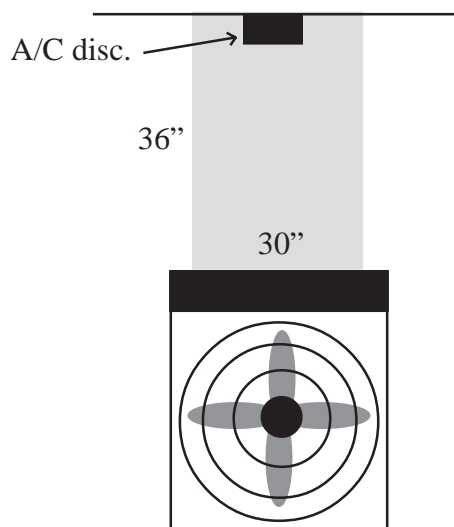


Location of A/C disconnect

2006

The mounting of A/C disconnects when a **NEW** circuit is installed. The disconnect shall have clearances as shown by the shaded area.

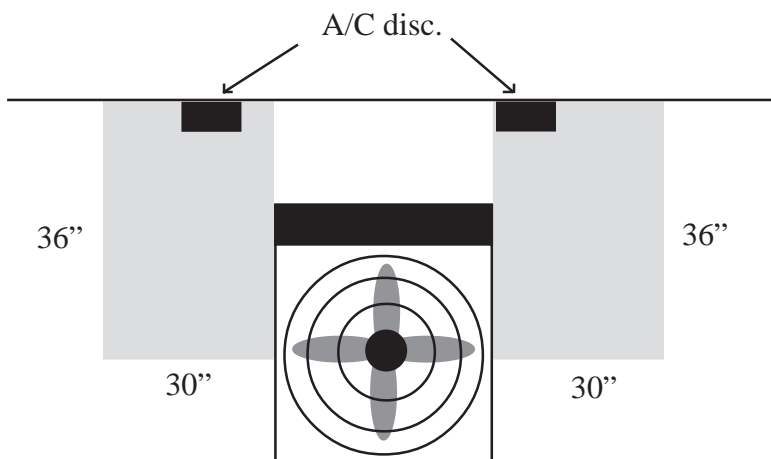

NEW Requirements on CHANGE OUTS Effective September 1, 2006

The location of A/C disconnects when they are **CHANGING OUT** an a/c unit and using an existing disconnect. The existing disconnect would need the clearances as shown in the shaded area. If the disconnect is between the a/c unit and the building the bottom of the disconnect **MUST** be higher than the top of the a/c unit and have the clearances shown in the shaded area.

